




Quick Start Card


in.yj-3-ce™ European version

1- Connect all outputs & keypads

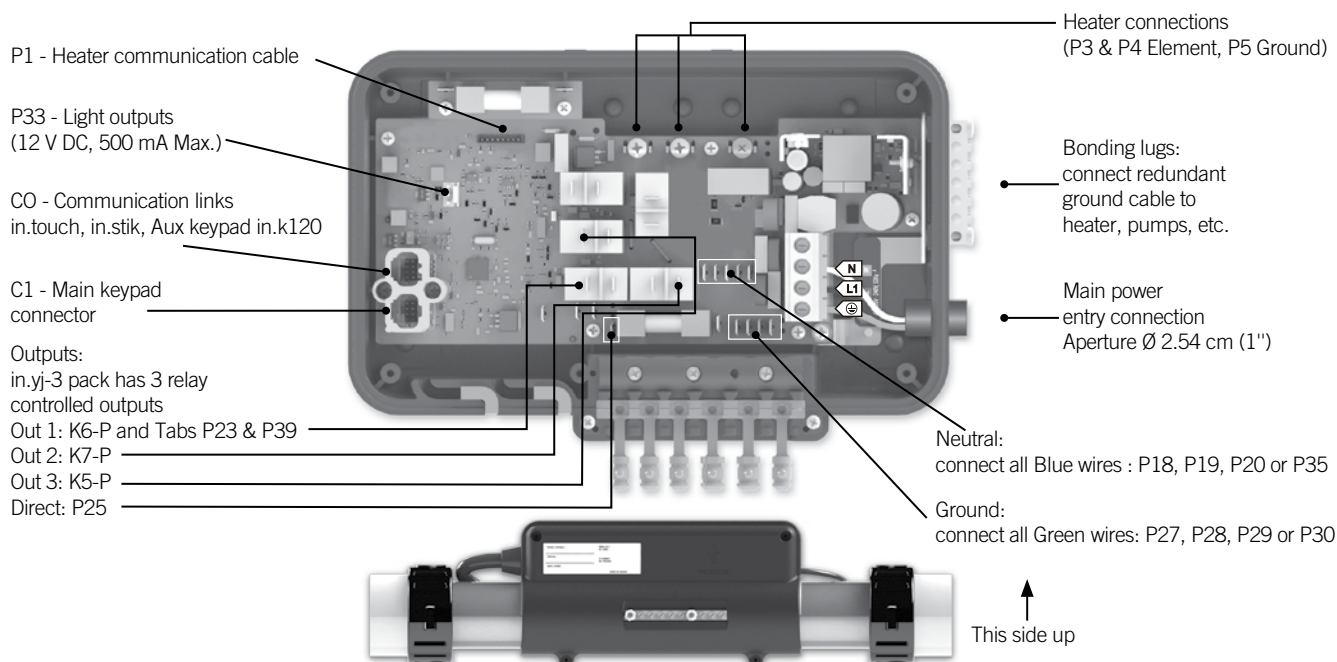

75 L/min (20 GPM) minimum water flow required.

2- Connect the main power

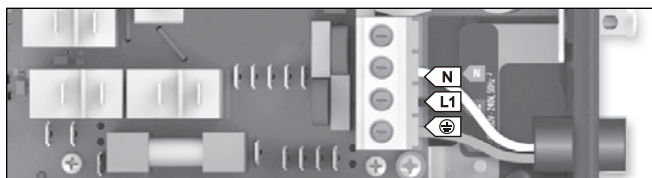


230 V, 50 Hz (3 wires): The in.yj supports single phase input with up to 40Amp.


WARNING!

in.yj.ce models must always be connected to a circuit protected by a Residual-Current Device (RCD) having a rated operating residual-current not exceeding 30 mA. Correct wiring of the electrical service box, RCD, and pack terminal block is essential! Check your electrical code for local regulations. Only copper wire should be used, never aluminum.

3- Select spa configuration (see chart next page)

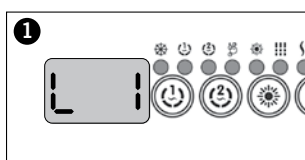

At first startup the keypad display will show **L 1** or **LL 1**.

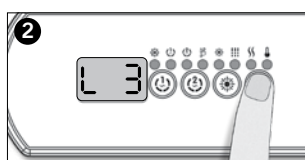

Use the **Up/Down** key to choose the new low level configuration number.



Press the **Program** key to confirm the selection.

For more information, see our website: www.geckoalliance.com


Note: To re-enter the Low level selection menu, hold the **Pump 1** key for 30 seconds.

Note: If the keypad does not have a **Program** or **Filter** key, use the **Light** key instead.

Note: For the **Color keypad series**, select **Settings menu**, go into **Electrical config** and choose the appropriate Low level.

4- Select breaker current

Specify the current rating and the number of phases of the RCD used to ensure safe and efficient current management (and no RCD trippings).

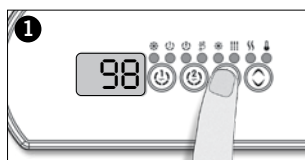

Press and hold the **Program** key for 20 seconds until you access the breaker setting menu.


Note: For the **Color keypad series**, select **Settings menu**, go into **Electrical config** and choose input current.



Current setting

# of phases	Current setting range
1	10 to 40 A

The values displayed by the system correspond to the maximum amperage capacity of the RCD.h



Use the **Up/Down** key to select the desired value. Then press the **Program** key to confirm the selection.

Note: If the keypad does not have the **Program** or **Filter** key, use the **Light** key instead.

For more information, see our website: www.geckoalliance.com



Configuration selection chart

Software #287, rev. 001

Standard config. #	Pump 1	Pump 2	Blower	DIRECT 1	Circ. Pump (CP) configuration	Ozone (O3) configuration ¹	Filter cycle daily	Heater
10	2SP (K7-P, K6-P) 8A-3A	-	-	-	-	(K5-P)	2 x 2 hours with P1L	with P1 6A
11	1SP (K7-P) 4A	-	-	-	-	(K6-P)	2 x 2 hours with P1L	with P1 6A
20	2SP (K7-P, K6-P) 8A-3A	-	-	-	-	(K5-P)	2 x 2 hours with P1L	with P1 9A
21	1SP (K7-P) 4A	-	-	-	-	(K6-P)	2 x 2 hours with P1L	with P1 9A
22	2SP (K7-P, K6-P) 8A-3A	1SP (K5-P) 8A	-	-	-	-	2 x 2 hours with P1L	with P1 9A
23	2SP (K7-P, K6-P) 8A-3A	-	(K5-P) 4A	-	-	-	2 x 2 hours with P1L	with P1 9A
30	2SP (K7-P, K6-P) 8A-3A	-	-	-	-	(K5-P)	2 x 2 hours with P1L	with P1 12A
31	1SP (K7-P) 4A	-	-	-	-	(K6-P)	2 x 2 hours with P1L	with P1 12A
32	2SP (K7-P, K6-P) 8A-3A	1SP (K5-P) 8A	-	-	-	-	2 x 2 hours with P1L	with P1 12A
33	2SP (K7-P, K6-P) 8A-3A	-	(K5-P) 4A	-	-	-	2 x 2 hours with P1L	with P1 12A
40	2SP (K7-P, K6-P) 8A-3A	-	-	-	-	(K5-P)	2 x 2 hours with P1L	with P1 16A
41	1SP (K7-P) 4A	-	-	-	-	(K6-P)	2 x 2 hours with P1L	with P1 16A
42	2SP (K7-P, K6-P) 8A-3A	1SP (K5-P) 8A	-	-	-	-	2 x 2 hours with P1L	with P1 16A
43	2SP (K7-P, K6-P) 8A-3A	-	(K5-P) 4A	-	-	-	2 x 2 hours with P1L	with P1 16A

¹ When the Ozonator is not controlled by a relay, it can be tied to Pump 1 Low speed or Circ. Pump, by using a cable splitter AMP PN: 9920-401369.

Glossary

P1	Pump 1
P1L	Pump 1 low speed
1SP	Pump one speed (High speed only)
2SP	Pump two speed (High and Low)

For complete TechBook or more information, see our website: www.geckoalliance.com